


## Chapter NR 812


### APPENDIX

**Figure 1. Pitless unit connections for wells with steel well casing pipe.**

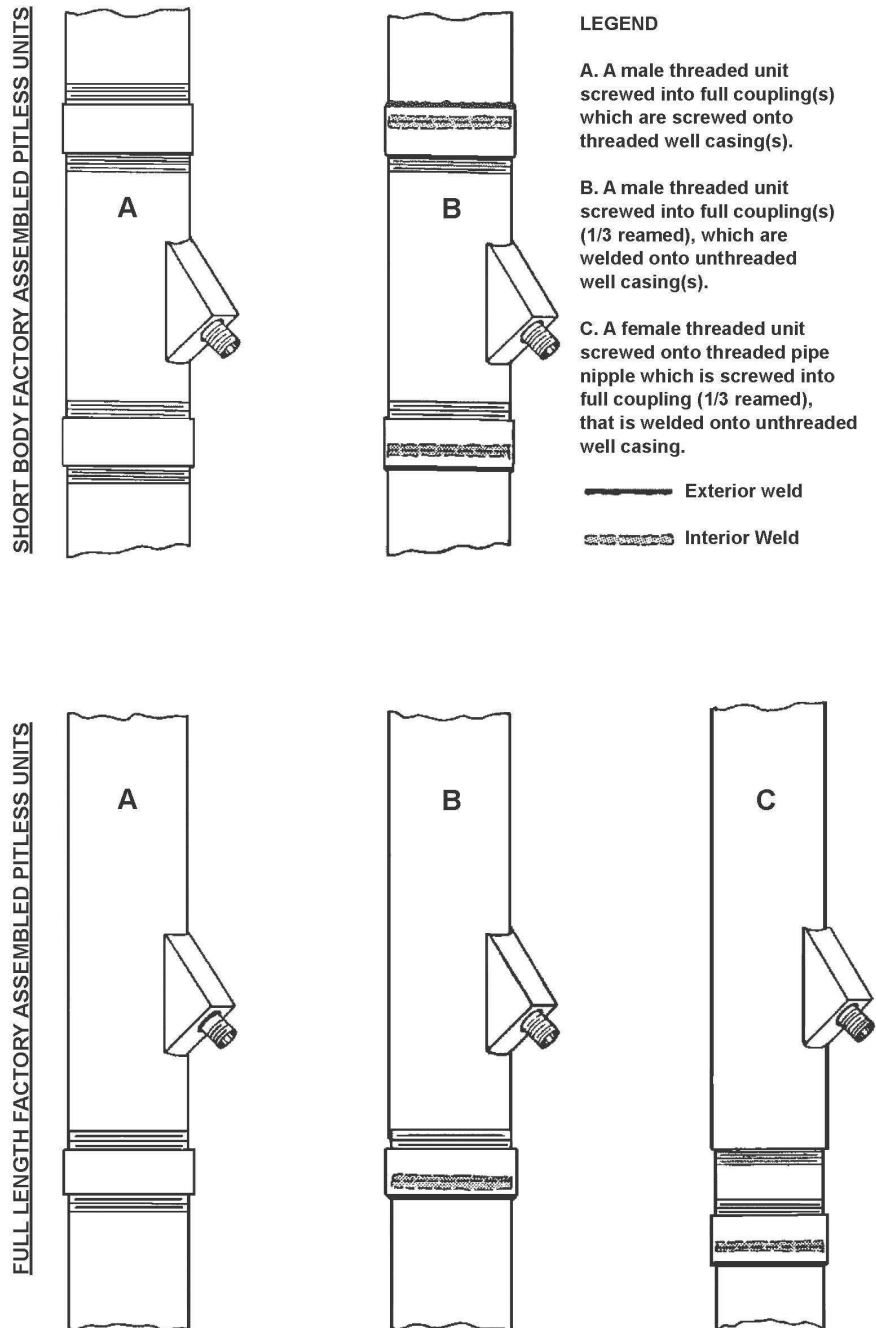


**Figure 2. Pitless unit connections for wells with thermoplastic well casing pipe.**

**SHORT BODY FACTORY ASSEMBLED PITLESS UNITS**

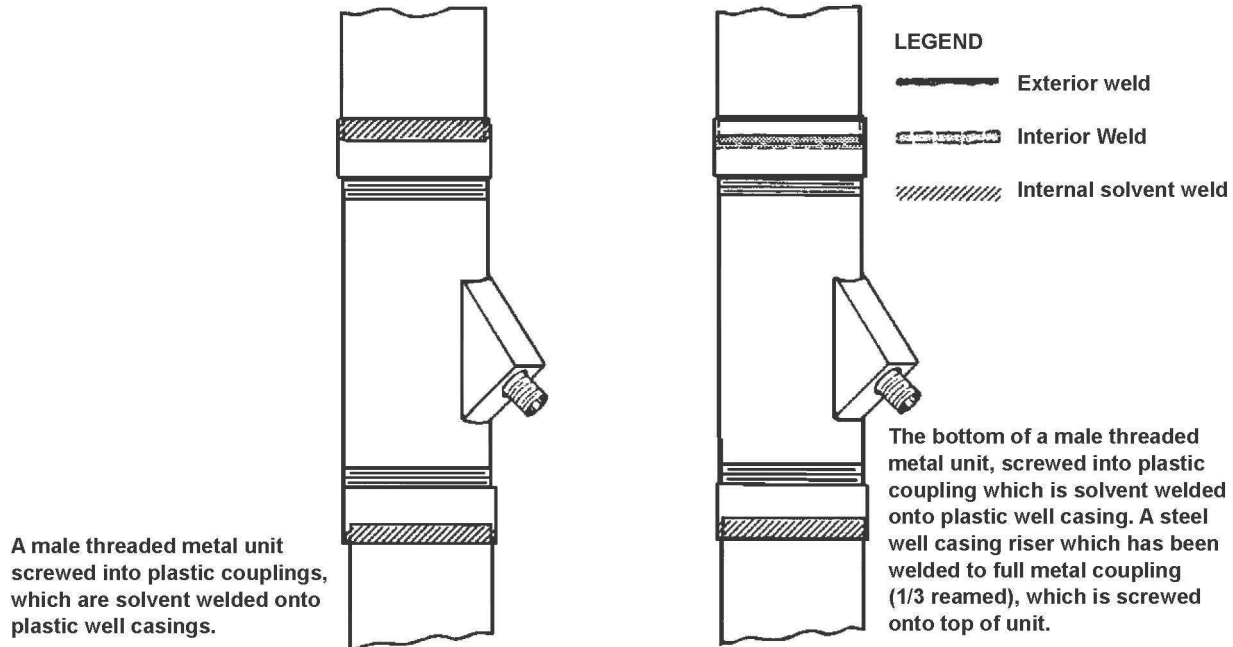

**FULL LENGTH FACTORY ASSEMBLED PITLESS UNITS**

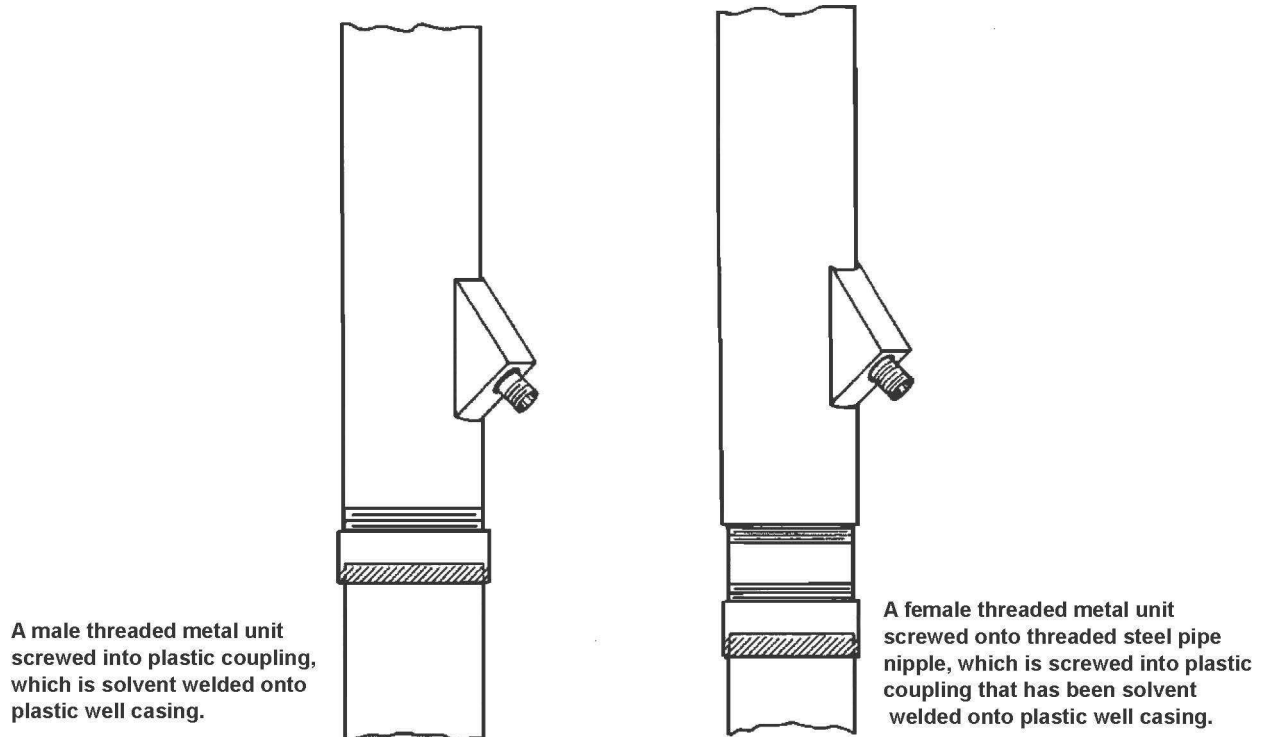

**Figure 3. High capacity well pump installation depicting pumpage and water level measuring devices, well vents and air-relief vacuum breakers.**

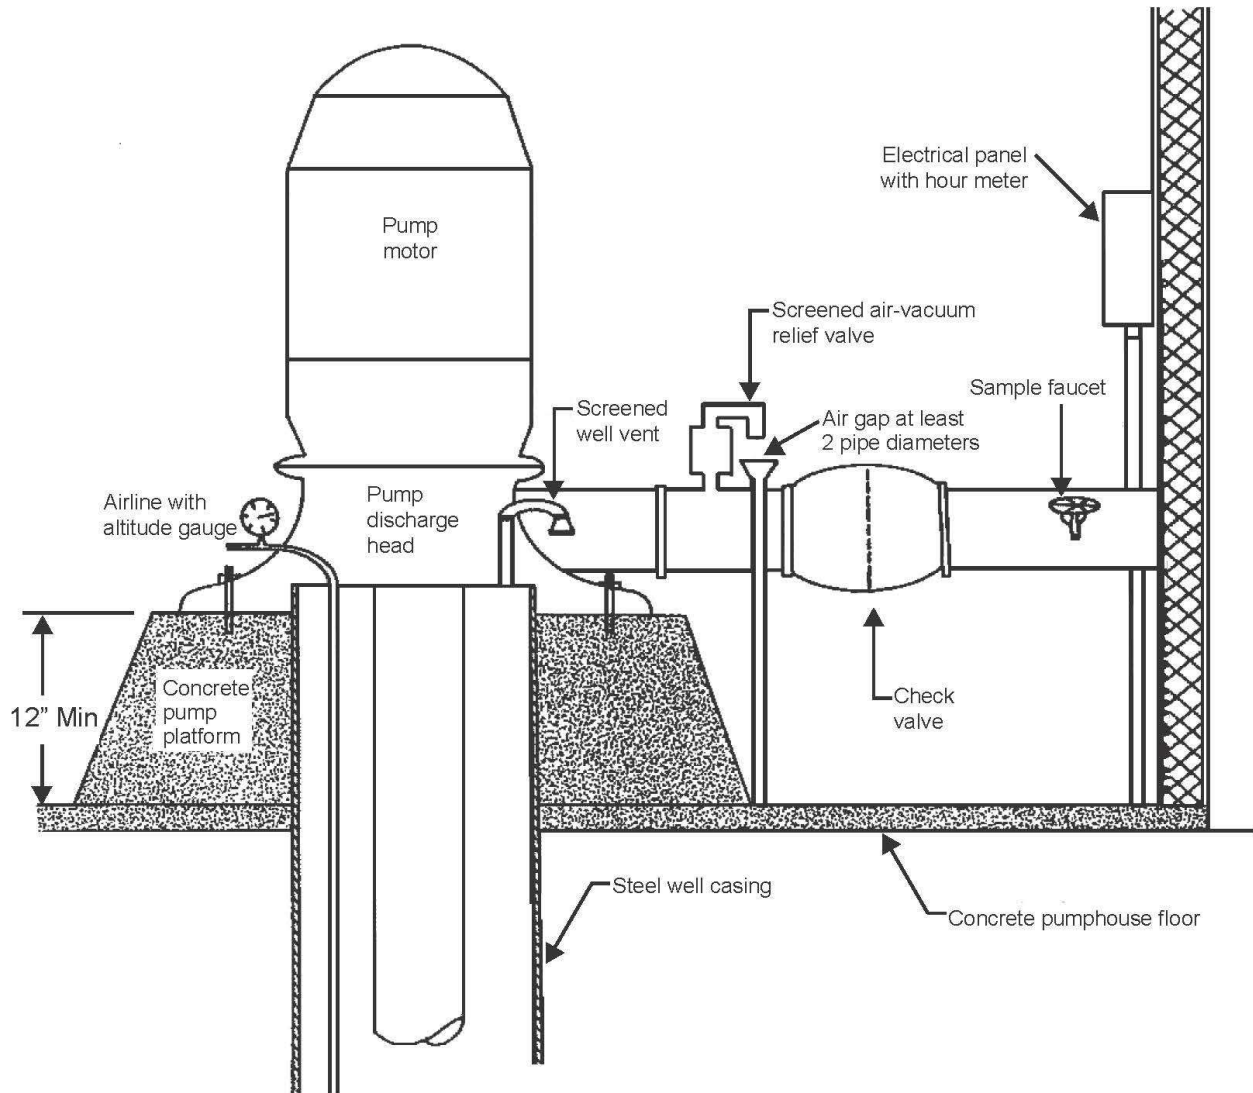


Figure 4. Flowing well - Overflow piping arrangement with a submersible pump.


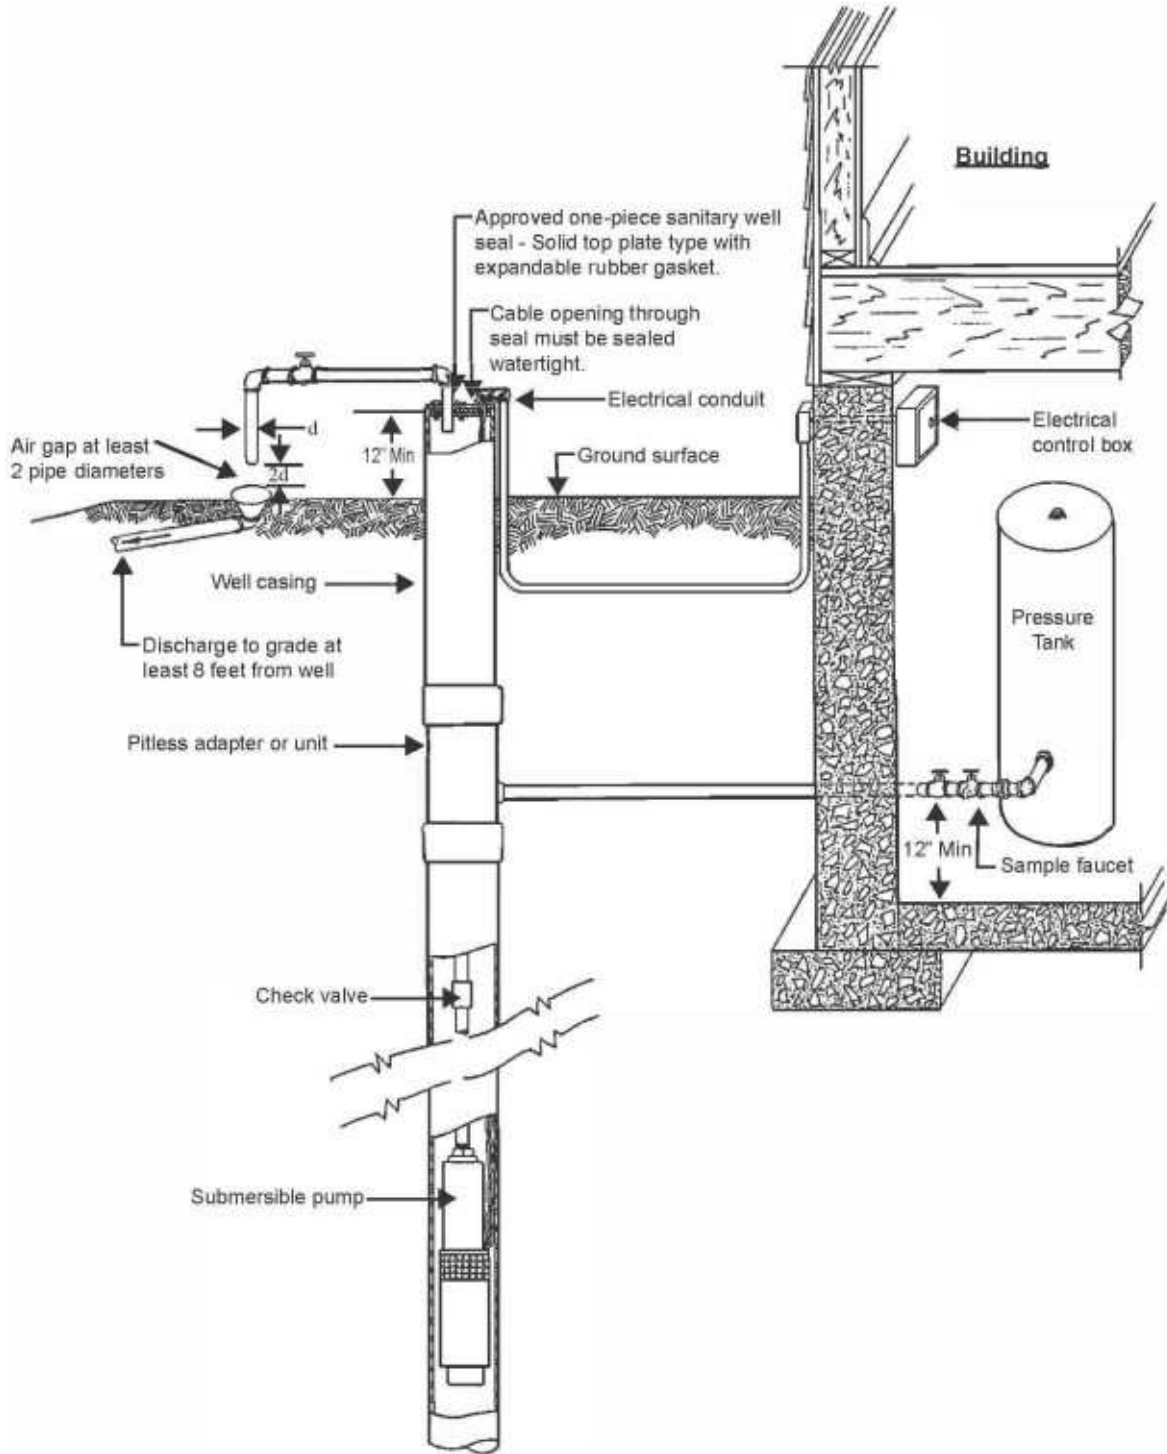


Figure 5. Flowing well - surge tank installation.



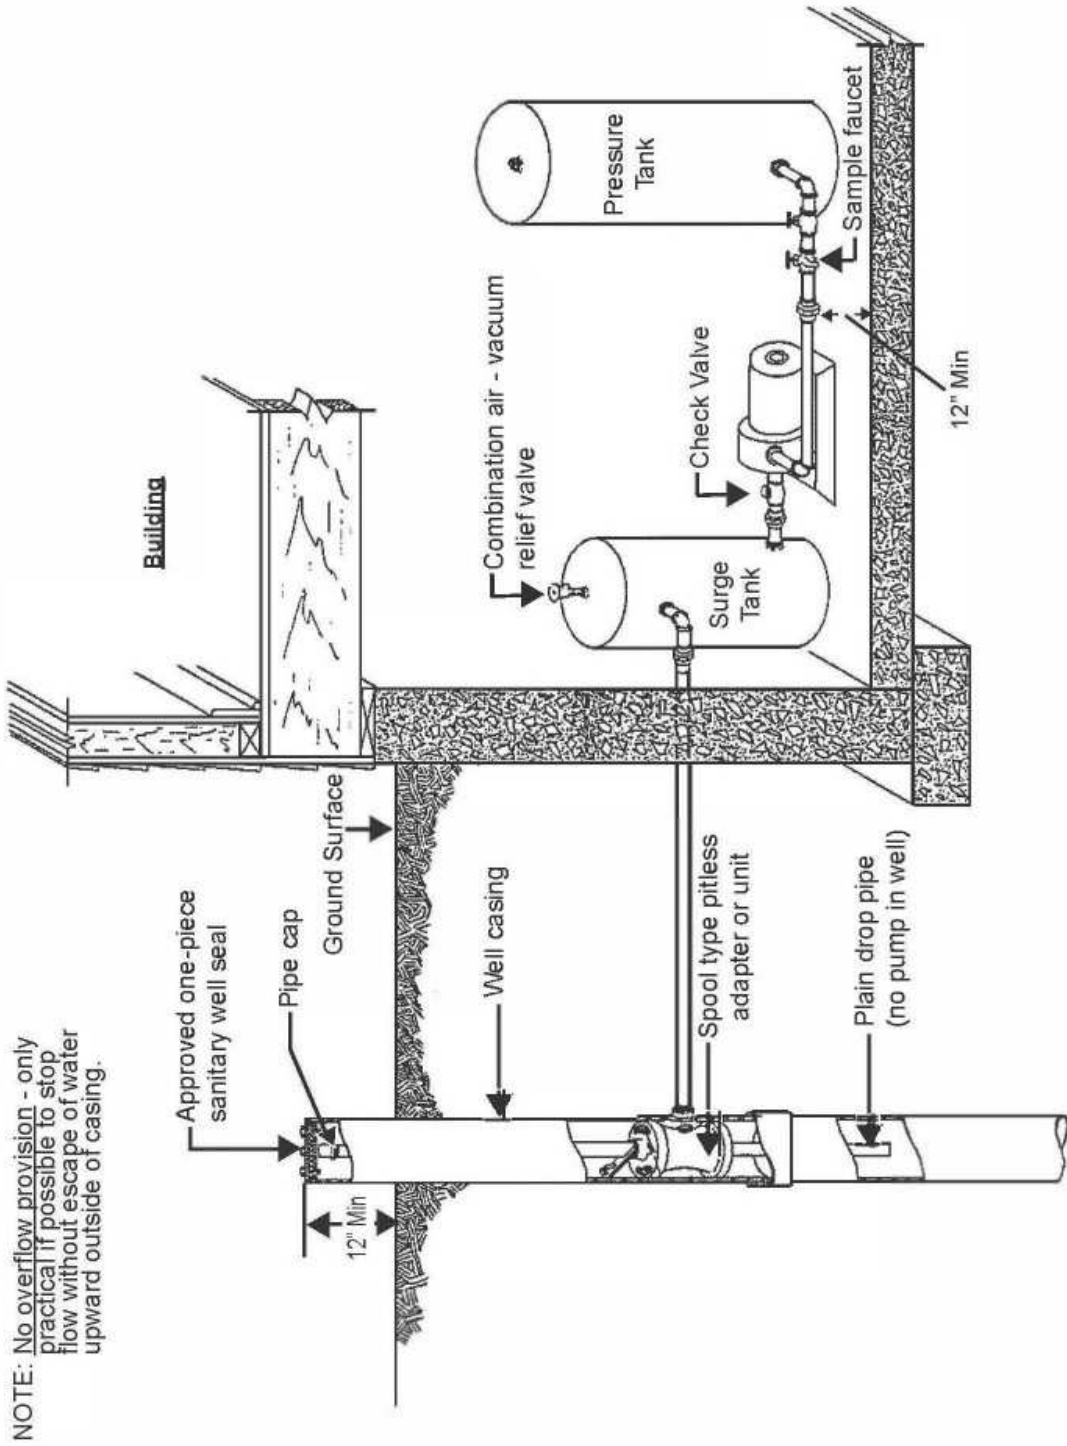

**Figure 6. Flowing well - Overflow piping arrangement with a surge tank and no pump.**

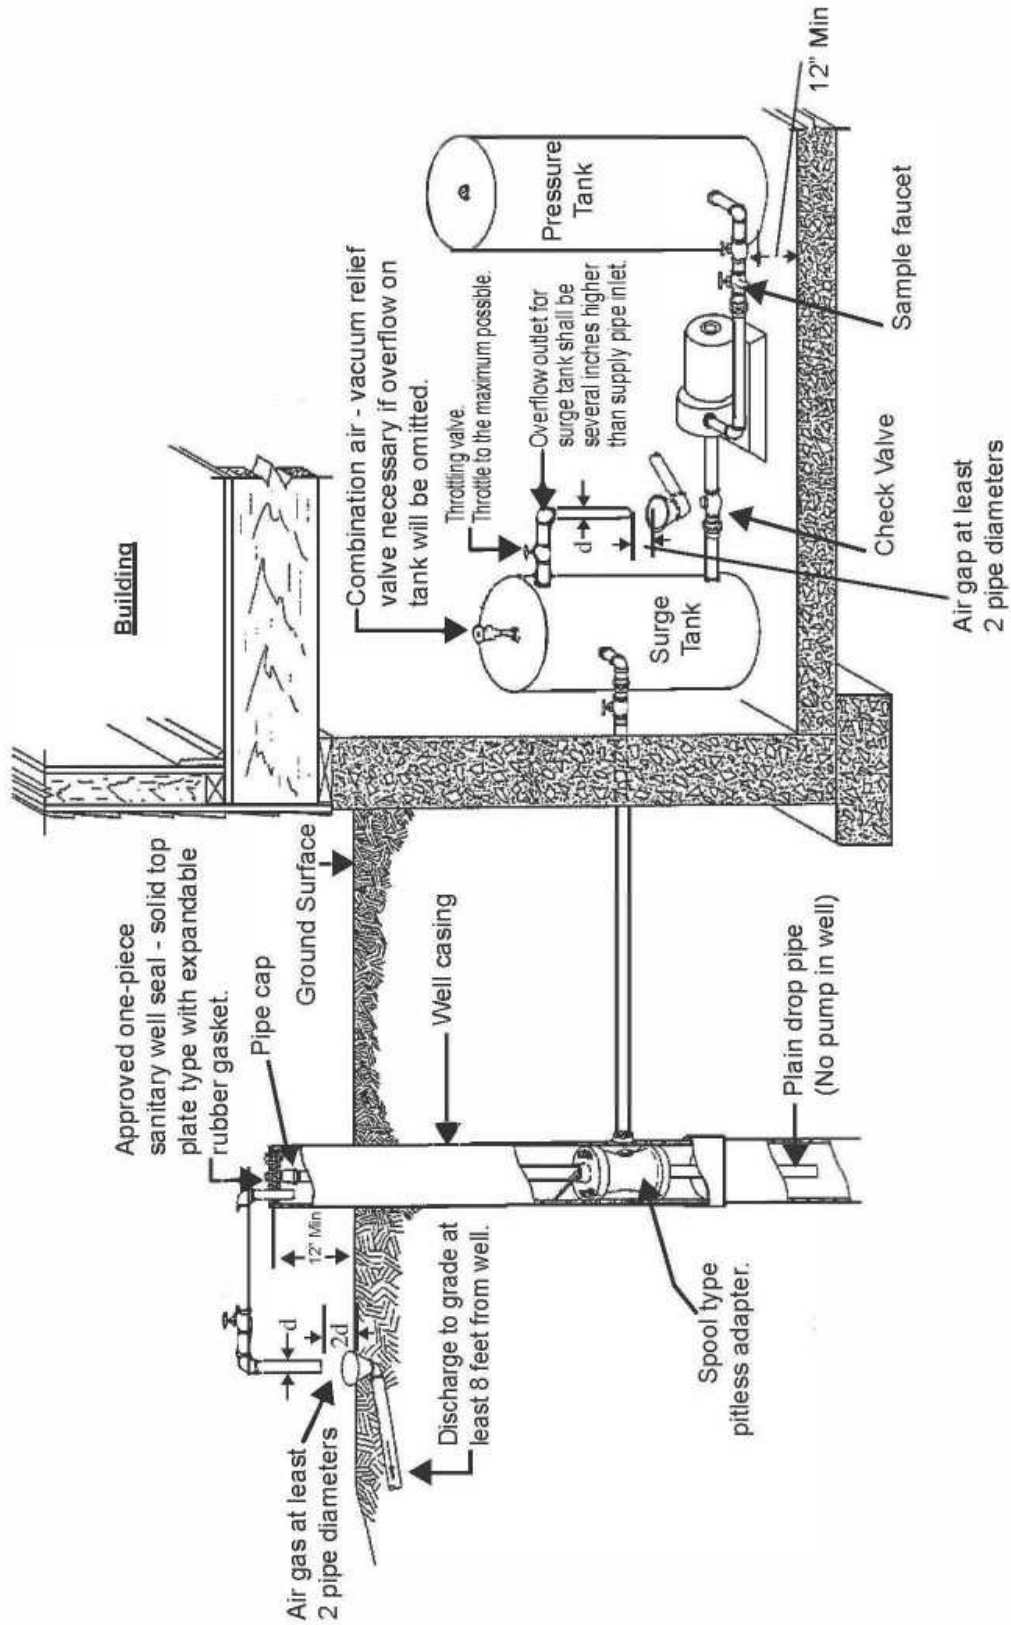


Figure 7. Reservoir specifications.

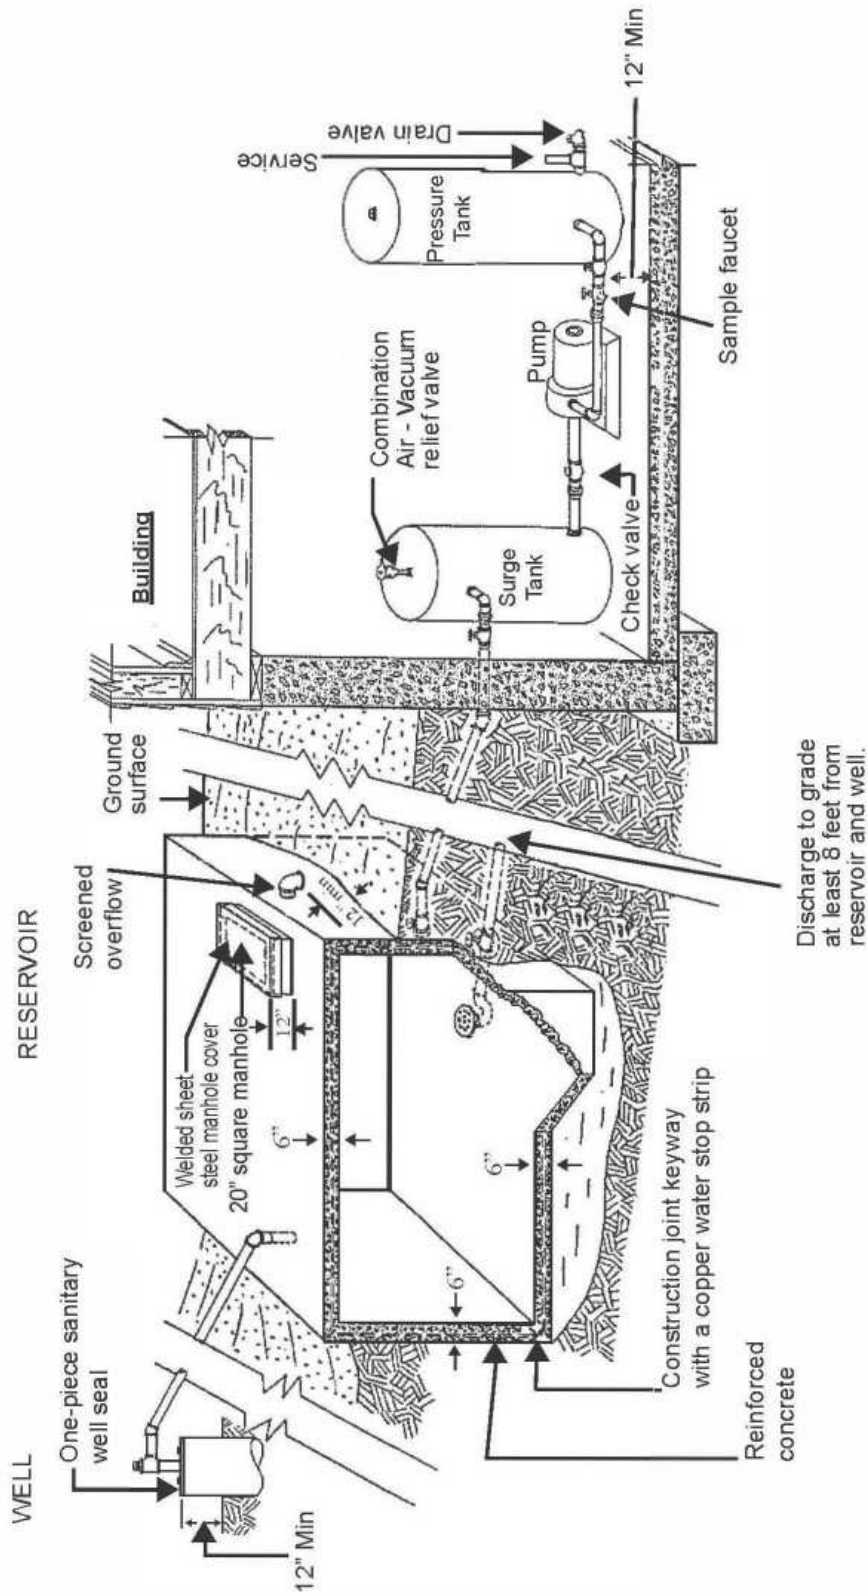


Figure 8. Well pits - Minimum requirements

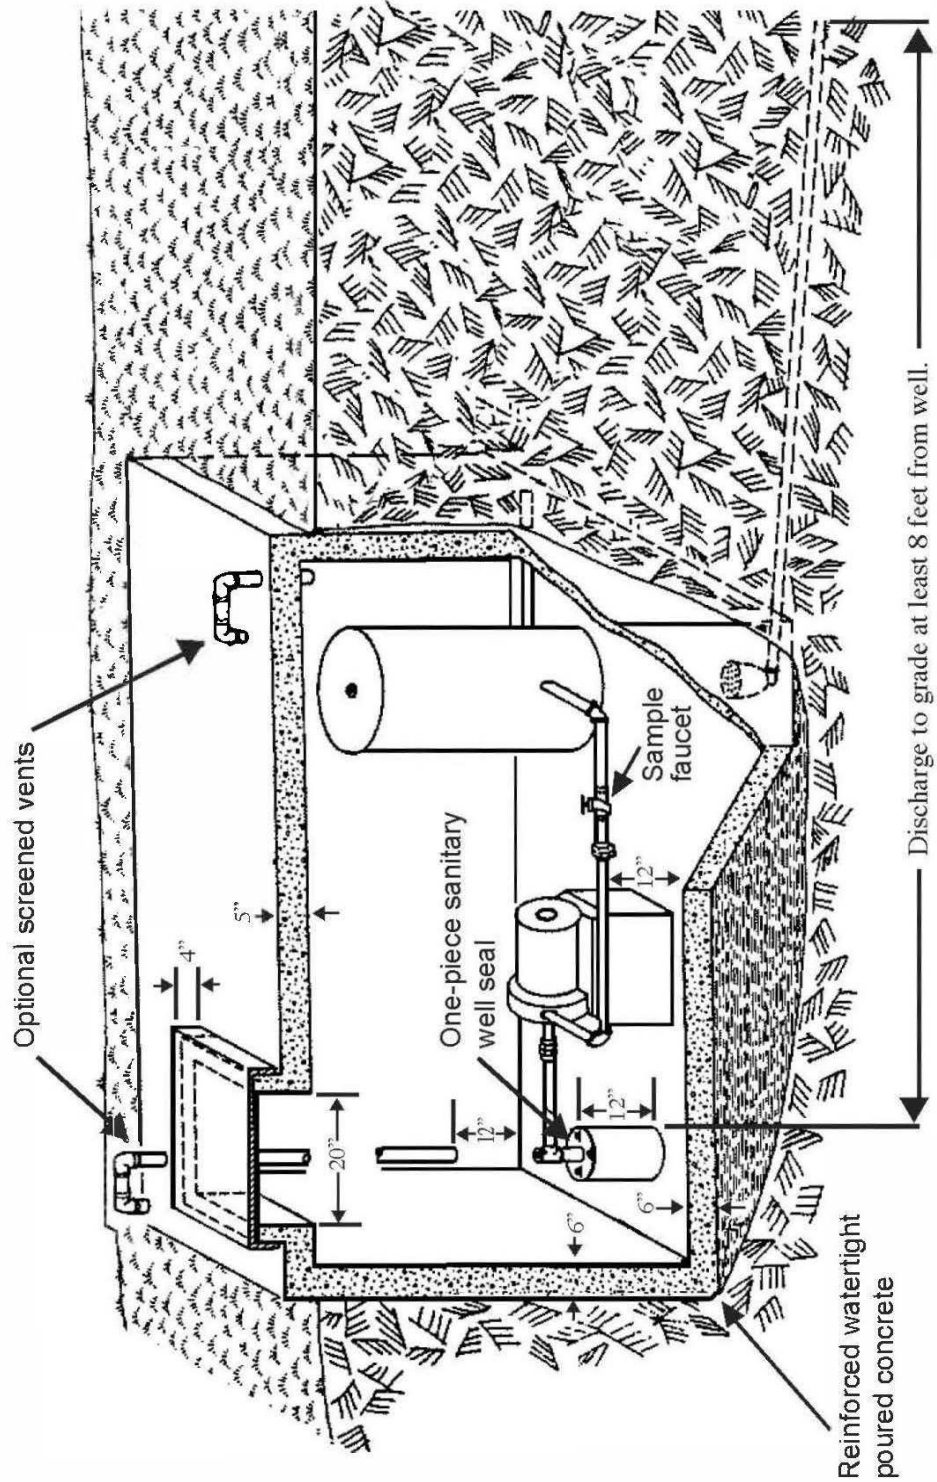




Figure 9. Driveway Ramp Installation



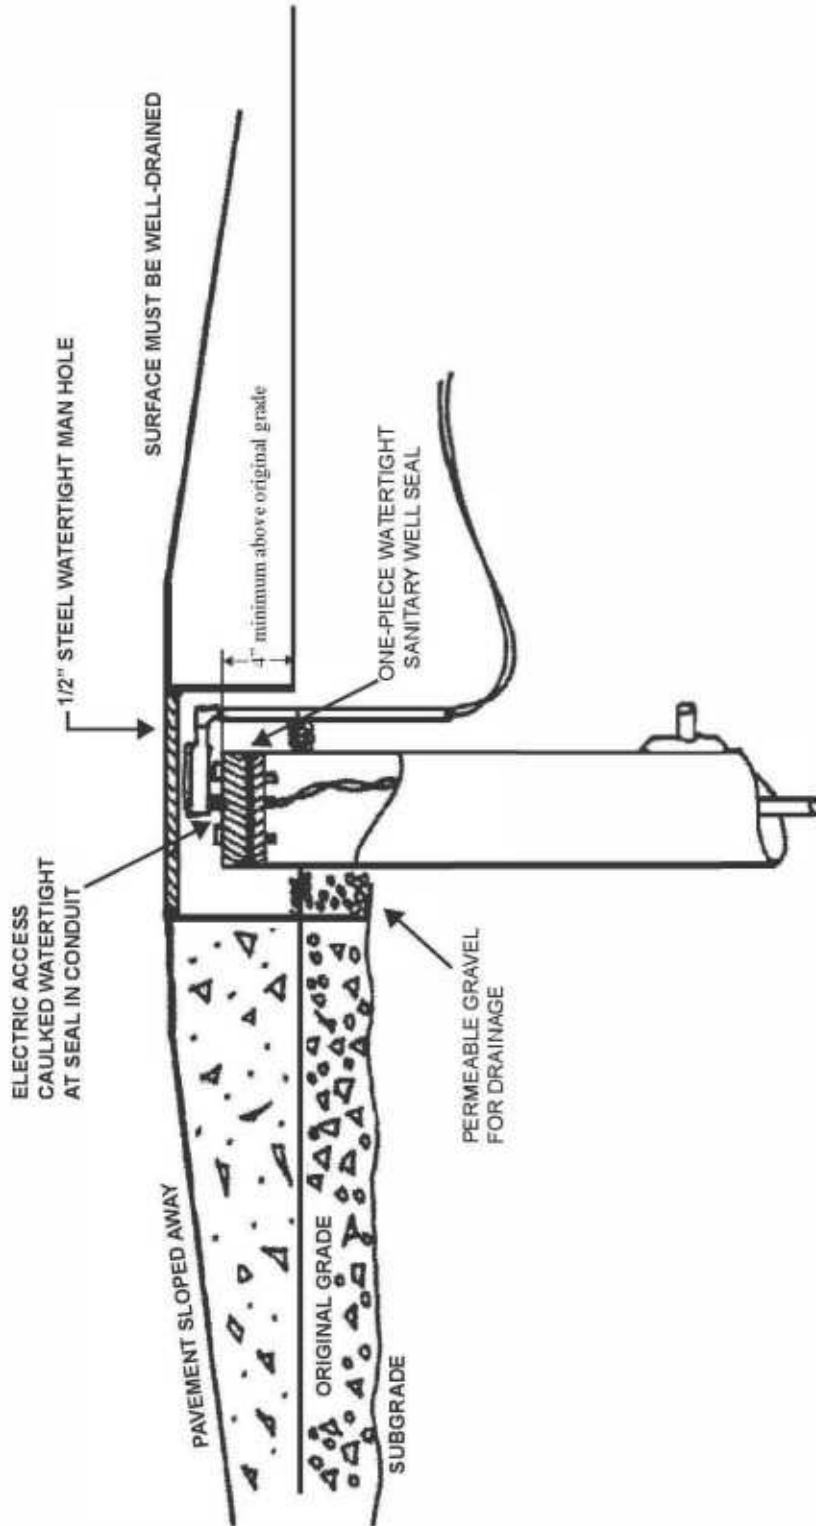



Figure 10. Well pits - Minimum requirements for pits installed on or before April 10, 1953.

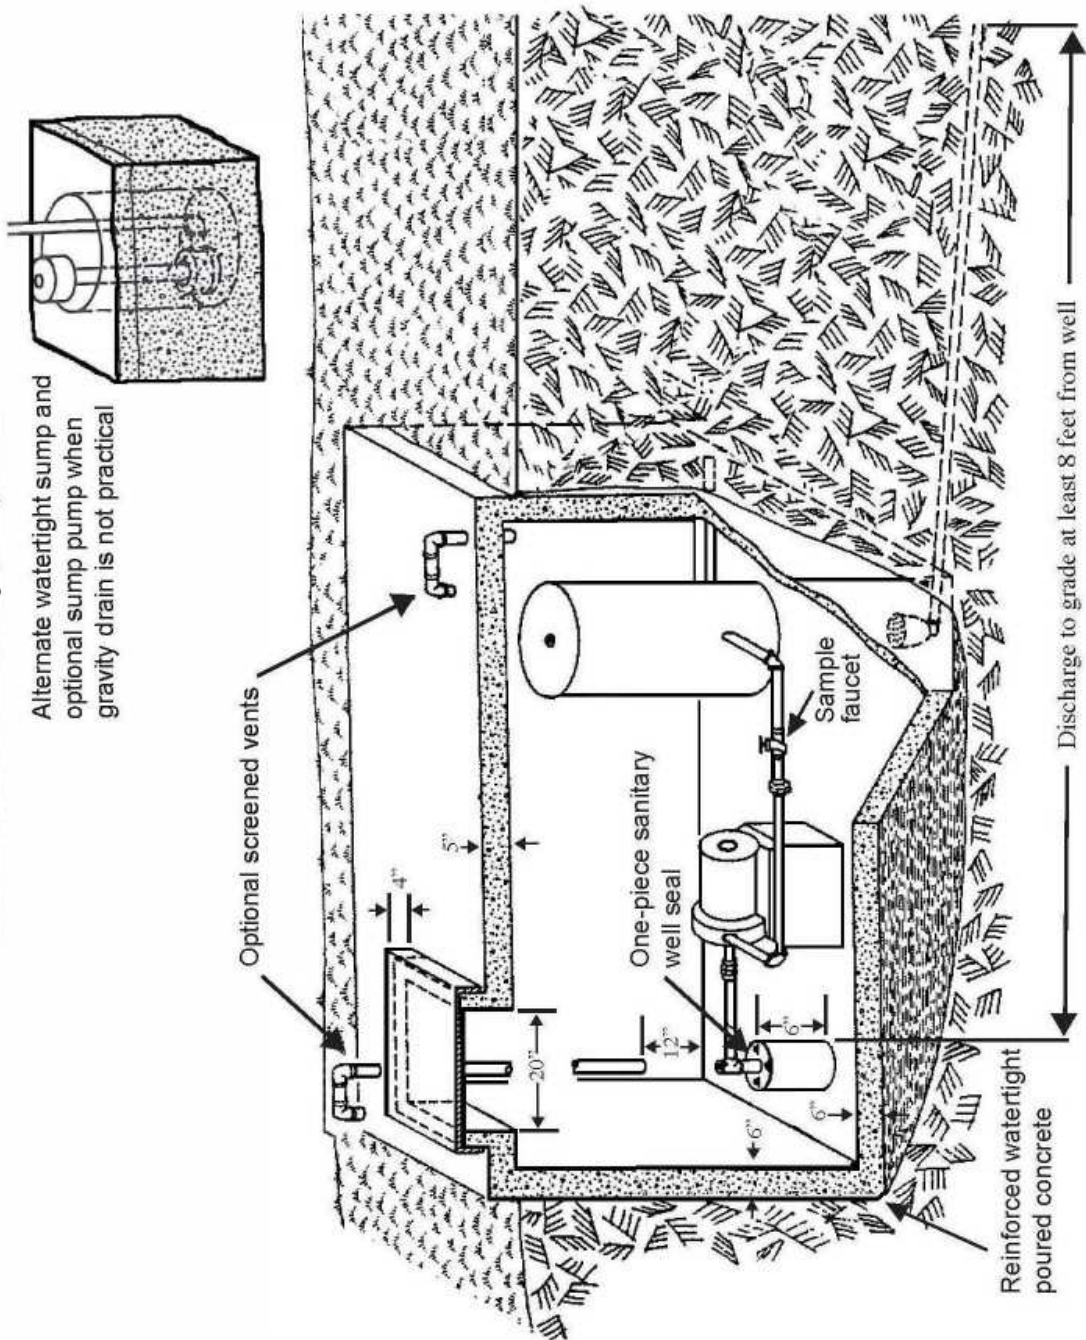

**Figure 11. Alcove - Requirements for an alcove installed on or before April 10, 1953**

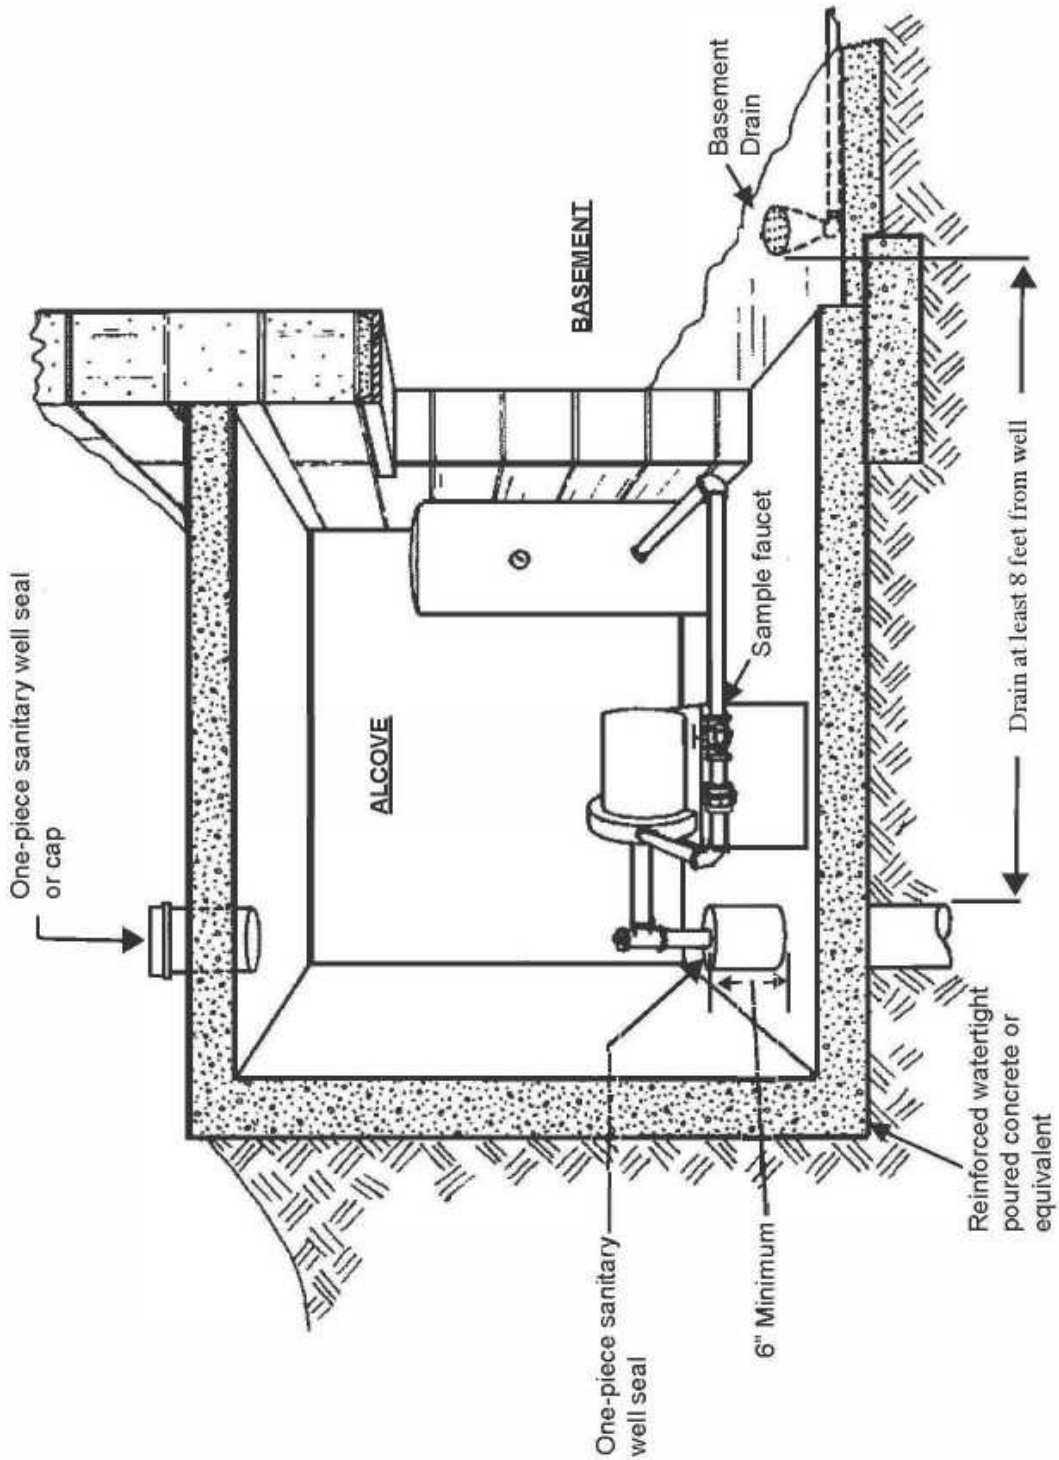

**Figure 12. Minimum requirements for pump installations for wells with nonpressurized conduit installed prior to February 1, 1991**

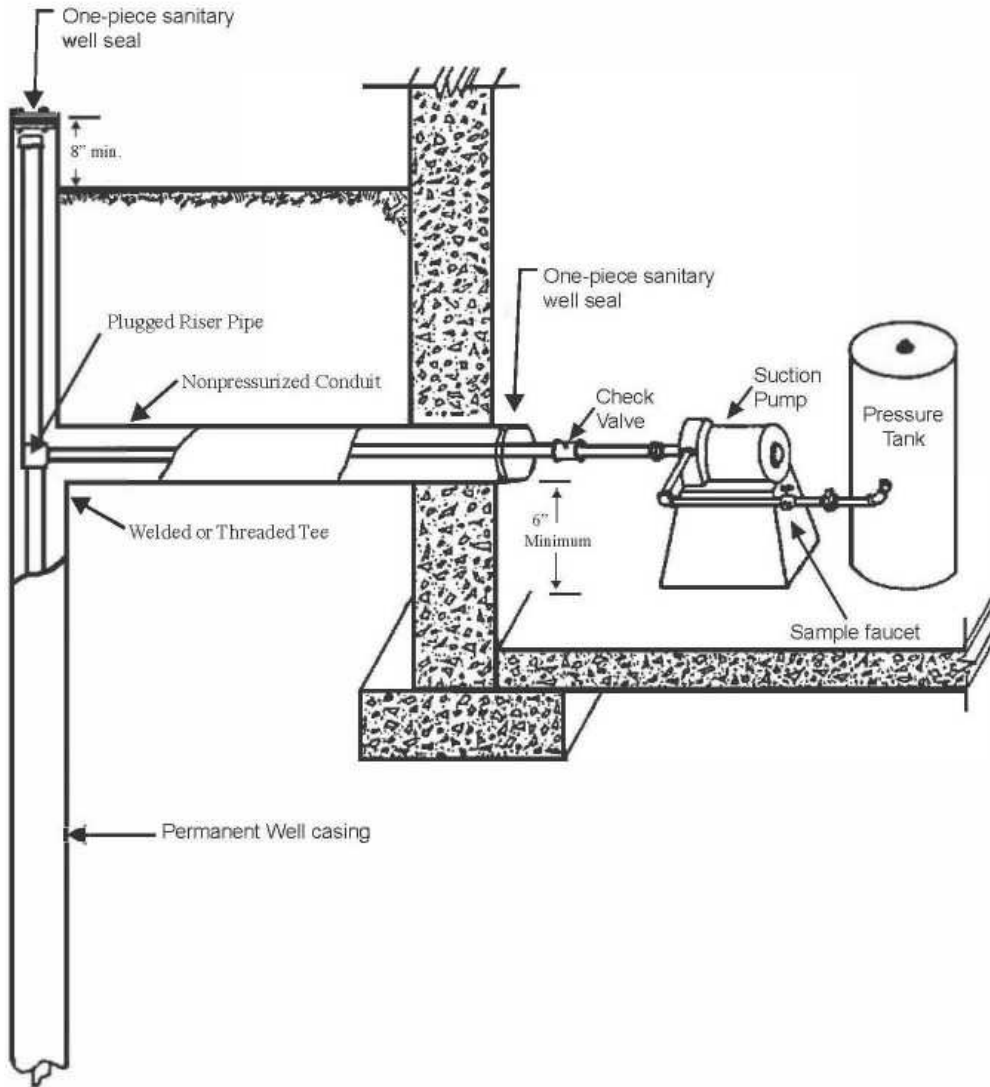



**Figure 13. Pump installation for a deep well jet pump assembly and a nonpressurized conduit installed prior to February 1, 1991**

